

The Department of Energy has published updated energy efficiency metrics for central air conditioners and heat pumps. This publication reflects both the 1987 metric (SEER) and the 2023 metric (SEER2). Efficiency requirements are published at 10 C.F.R. 430.32(c). Please refer to www.AHRInet.org for more information about updated energy efficiency metrics.

U.S. Government

Federal law prohibits removal of this label before consumer purchase.

ENERGYGUIDE




Heat Pump
Cooling and Heating
Split System

MRCOOL
Model A-09-HP-C-230C

Cooling Efficiency Rating (SEER)*

18.50 - 20.00

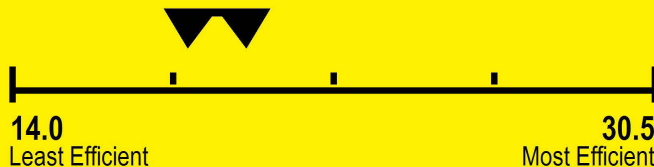


Range of Similar Models

* Seasonal Energy Efficiency Ratio


Heating Efficiency Rating (HSPF)*

10.00 - 10.80

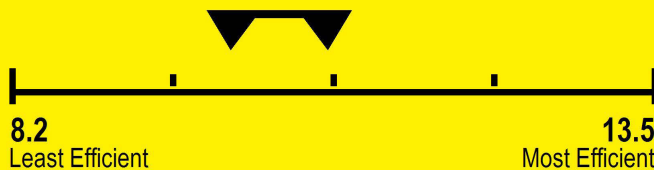

Range of Similar Models

* Heating Seasonal Performance Factor

 This system's efficiency ratings depend on the coil your contractor installs with this unit. The heating efficiency rating varies slightly in different geographic regions. Ask your contractor for details.

For energy cost info, visit
productinfo.energy.gov

U.S. Government

Federal law prohibits removal of this label before consumer purchase.

ENERGYGUIDE


Heat Pump
Cooling and Heating
Split System

MRCOOL
Model A-09-HP-C-230C



Cooling Efficiency Rating (SEER2)**

20.80 - 20.90

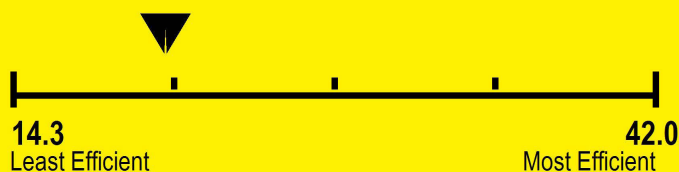


Range of Similar Models

** Seasonal Energy Efficiency Ratio 2

Heating Efficiency Rating (HSPF2)**

8.00 - 8.70

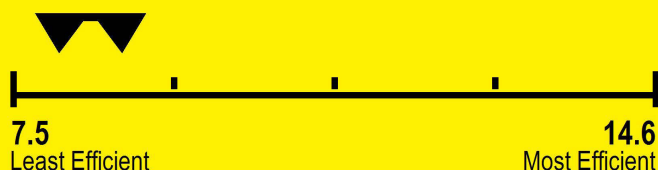

Range of Similar Models

** Heating Seasonal Performance Factor 2

▼▼ This system's efficiency ratings depend on the coil your contractor installs with this unit. The heating efficiency rating varies slightly in different geographic regions. Ask your contractor for details.

For energy cost info, visit
productinfo.energy.gov